

TOTO®

## Standard EcoPower® Faucet with Mixing Valve

TEL105-D10ET - 10 sec-cycle on-demand (0.09gpc) w/ thermostatic valve  
TEL105-C20ET - 20 sec-cycle continuous (0.19gpc) w/ thermostatic valve  
TEL105-D10EM - 10 sec-cycle on-demand (0.09gpc) w/ mixing tee  
TEL105-C20EM - 20 sec-cycle continuous (0.19gpc) w/ mixing tee

Ideal for high-traffic commercial spaces, the TOTO Standard EcoPower sensor faucets provide an elegant water conservation solution for LEED option. Powered by water, EcoPower's turbine creates an electrical current that is stored in rechargeable cells to power the Smart Sensor System of the faucet. The mixing valve is available in a thermostatic or mixing tee option.



### Performance Dashboard

#### Features & functionality

Hydropower self generating system  
No minimum daily usage requirement  
Micro-sensor positioned underneath the spout head for accurate hand detection ensuring smooth and consistent water distribution  
Durable chrome plated spout body  
Single-hole mount  
Kit includes spout body, controller box, and mounting hardware – less supply lines  
Equipped with 0.5gpm flow control  
Mixing valve options available

Visit TOTO for more product specifications for:  
[TEL105 Series](#)

#### Environmental performance

##### Improved by:

Powered by the sheer force of running water  
See [How we make it greener](#) for water savings information


Metal parts and electric components are recyclable at the end of service

##### Certifications & rating systems:

CALGreen® compliant  
Declare™ Label  
Contributes to earning credits in LEED®

[See LCA results & interpretation](#)

[See material health results & interpretation](#)

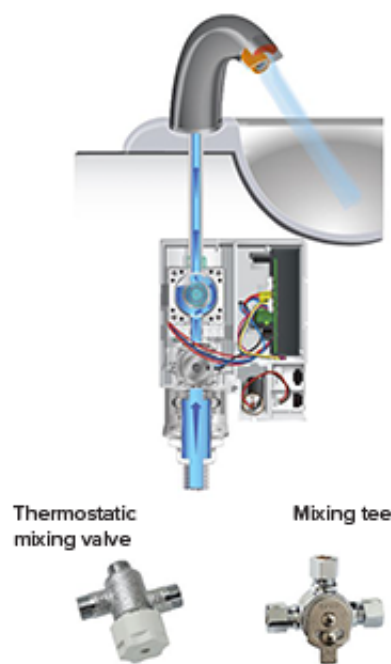

CSI MasterFormat™ #22 42 39



#### ECO-POWER® SELF-SUSTAINING FAUCETS

- Powered by water to create an electrical current that is stored in rechargeable cells to power the Smart Sensor System of the faucet or valve.
- Reduces electricity use, lower maintenance costs and hands-free, automatic-shut-off functionality.



Declare.



## SM Transparency Report™ + Material Health Overview™

#### VERIFICATION

LCA

3rd party verified



Transparency Report

Verified



Material evaluation

Self-declared



Validity: 09/02/16 – 09/02/22  
TOT – 09/02/16 – 018

The LCA and Report are independently verified to the SM Transparency Report / EPD Framework and ISO 14025.

**NSF International**  
P.O Box 130140  
789 N.Dixboro Road  
Ann Arbor, MI 48105, USA  
[www.nsf.org](http://www.nsf.org)  
+1 734 769 8010



The material health evaluation is self-declared and done in accordance with the Manufacturers Guide to Declare.

**International Living Future Institute**  
501 East Madison St.  
Seattle, WA 98122  
[www.living-future.org](http://www.living-future.org)  
206 223 2028



#### TOTO USA

1155 Southern Road  
Morrow, GA 30260  
[www.totousa.com](http://www.totousa.com)

Contact us

## LCA results & interpretation

## Standard EcoPower® Faucet with Mixing Valve

### Life cycle assessment

### Material health

#### Scope and summary

☒ Cradle to grave ☐ Cradle to gate with options ☐ Cradle to gate

#### Functional unit

One faucet in an average U.S. commercial environment for 3 years. The period of 3 years is modeled as the period of application based on the average technical lifespan for commercial applications. The economical lifespan of commercial applications can be longer or shorter due to aesthetic replacements or more intense use. The implication is that the LCA model assumes that the application ends at year 3 and that the materials will be treated in an end-of-life scenario.

Reference service life: 3 years

Data reporting period: 2015

#### Default use phase scenario


TEL105-D10ET and TEL105-D10EM: 3 years of service in an average U.S. commercial environment with 0.09 gallon/use and 133 uses/day resulting in 13,107.15 gallons of water.

TEL105-C20ET and TEL105-C20EM: 3 years of service in an average U.S. commercial environment with 0.19 gallon/use and 133 uses/day resulting in 27,670.65 gallons of water.

#### Material composition greater than 1% by weight

PART	MATERIAL	AVG. % WT.
Spout body	Brass (C36000)	13.0%
Packaging	Cardboard	12.8%
Controller box cover	ABS	10.4%
Mixing valve body	Brass	7.4%
Spout mounting bracket	Stainless steel, SUS303	6.4%
Spout mounting nut	Brass	5.1%
Spout mounting rod	Stainless steel, SUS304	4.8%
Hose	PVC	4.8%
Controller adapter	Brass, Pb free	4.2%
Controller mounting bracket	Stainless steel, SUS303	2.2%
Generator coil	Copper	1.8%
Connector	Polypropylene	1.7%
Nozzle base	Polyacetal	1.6%
Spout aerator gasket	NBR	1.6%
Spout nozzle key	Brass	1.6%
Hose clip	Steel	1.6%
Manuals	Paper	1.2%
Board	Electronics	1.1%
Generator coil cover	Brass	1.1%
	Other	15.5%

#### Total impacts by life cycle stages [mPts/func unit]

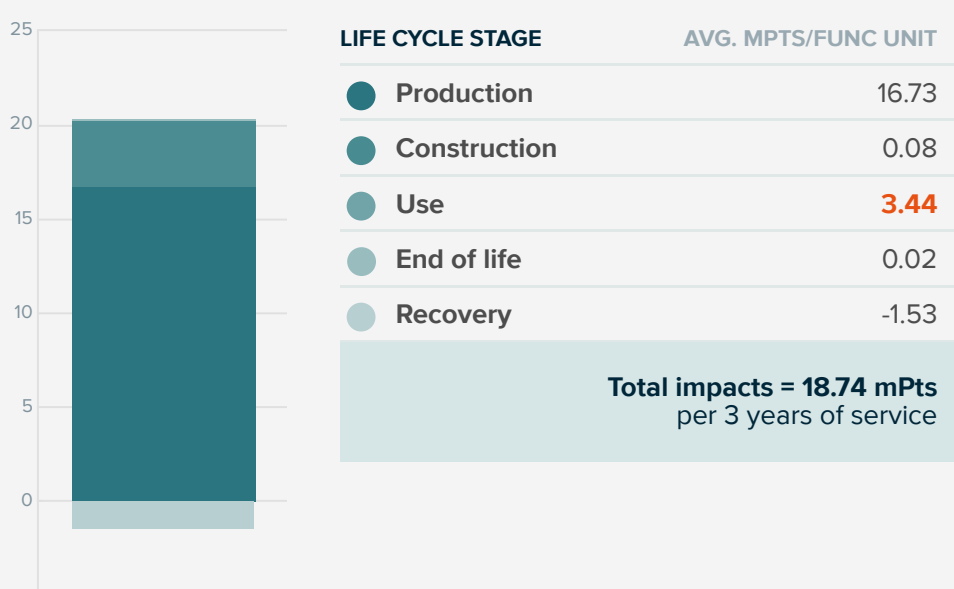

## LCA results

LIFE CYCLE STAGE	PRODUCTION	CONSTRUCTION	USE	END OF LIFE	RECOVERY
Information modules: Included   Excluded	<b>A1 Raw Materials</b>	<b>A4 Transportation/ Delivery</b>	<b>B1 Use</b>	<b>C1 Deconstruction/ Demolition</b>	<b>D Reuse, recovery and/or recycling</b>
	<b>A2 Transportation</b>	<b>A5 Construction/ Installation</b>	<b>B2 Maintenance</b>	<b>C2 Transportation</b>	
	<b>A3 Manufacturing</b>		<b>B3 Repair</b>	<b>C3 Waste processing</b>	
			<b>B4 Replacement</b>	<b>C4 Disposal</b>	
			<b>B5 Refurbishment</b>		
			<b>B6 Operational energy use</b>		
			<b>B7 Operational water use</b>		

### SM 2013 [Learn about SM Single Score results](#)

Impacts per 3 years of service	16.73 mPts	0.08 mPts	3.44 mPts	0.02 mPts	-1.53 mPts
Materials or processes contributing >20% to total impacts in each life cycle stage	Brass parts together with the printed wiring board in addition to manufacturing processes such as brass turning.	Transportation of the product to the installation site or consumer and disposal of packaging.	Volume of water use during the operation of the product and the embedded energy use in the water used.	Transport to waste processing, waste processing and disposal of material flows transported to a landfill.	Plastic and metal components' recycling processes.

### TRACI v2.1 results per one faucet

A variation of 10 to 20% | A variation greater than 20%

Life Cycle Stage			Production	Construction	Use	End of Life	Recovery
Ecological damage							
Impact Category	Unit						
Acidification	kg SO <sub>2</sub> eq		9.00E-01	8.73E-03	2.48E-01	1.42E-03	-2.40E-02
Ecotoxicity	CTU <sub>e</sub>		2.50E+02	1.90E+00	1.64E+01	2.89E-01	-1.40E+01
Eutrophication	kg N eq		5.05E-01	8.14E-04	2.73E-02	2.61E-04	-7.08E-03
Global warming	kg CO <sub>2</sub> eq		6.55E+01	9.35E-01	4.76E+01	2.42E-01	-2.22E+00
Ozone depletion	kg CFC-11 eq		4.58E-06	1.99E-09	2.16E-06	2.23E-08	-1.20E-07
Human health damage							
Impact Category	Unit						
Carcinogenics	CTU <sub>h</sub>		2.81E-06	1.07E-08	9.80E-07	3.29E-09	-4.61E-07
Non-carcinogenics	CTU <sub>h</sub>		9.66E-05	1.00E-07	4.04E-06	1.30E-07	-7.79E-06
Respiratory effects	kg PM <sub>2.5</sub> eq		1.09E-01	1.55E-04	1.67E-02	1.53E-04	-4.23E-03
Smog	kg O <sub>3</sub> eq		6.46E+00	2.80E-01	2.27E+00	2.89E-02	-2.55E-01
Resources depletion							
Impact Category	Unit						
Fossil fuel depletion	MJ surplus		4.25E+01	1.37E+00	2.87E+01	2.80E-01	-2.29E+00

## References

### LCA Background Report

TOTO Sanitary Fittings Products LCA Background Report (public version), July 2016

### SM Transparency Report Framework

Part A: LCA Calculation Rules and Background Report Requirements v2016 (compliant with ISO14040-44 and ISO14025)

Part B: Product Group Definition – [Commercial Faucets](#)

SM Transparency Reports / EPDs enable purchasers and users to compare the environmental performance of products on a life cycle basis. They are designed to present information transparently to make the limitations of comparability more understandable. SM Transparency Reports / EPDs of products that comply with the same PCR and include the same life cycle stages, but are made by different manufacturers, may not sufficiently align to support direct comparisons. They therefore, cannot be used as comparative assertions unless the conditions defined in ISO 14025 Section 6.7.2, 'Requirements for Comparability' are satisfied.

## Rating systems

The intent is to reward project teams for selecting products from manufacturers who have verified improved life-cycle environmental performance.

### LEED BD+C: New Construction | v4 - LEED v4

Building product disclosure and optimization

### Environmental product declarations

- ☐ Industry-wide (generic) EPD 1/2 product
- ☒ Product-specific Type III EPD 1 product

### Green Globes for New Construction and Sustainable Interiors

#### Materials and resources

- ☒ NC 3.5.1.2 Path B: Prescriptive Path for Building Core and Shell
- ☒ C 3.5.2.2 and SI 4.1.2 Path B: Prescriptive Path for Interior Fit-outs



## SM Transparency Report™ + Material Health Overview™

VERIFICATION	LCA
3rd party verified	<input checked="" type="checkbox"/> NSF
Transparency Report	
Verified	<input checked="" type="checkbox"/> NSF
Material evaluation	
Self-declared	<input checked="" type="checkbox"/>

The LCA and Report are independently verified to the SM Transparency Report / EPD Framework and ISO 14025.

NSF International  
P.O. Box 130140  
789 N. Dixboro Road  
Ann Arbor, MI 48105, USA  
[www.nsf.org](http://www.nsf.org)  
+1 734 769 8010



The material health evaluation is self-declared and done in accordance with the Manufacturers Guide to Declare.

International Living Future Institute  
501 East Madison St.  
Seattle, WA 98122  
[www.living-future.org](http://www.living-future.org)  
206 223 2028



TOTO USA  
1155 Southern Road  
Morrow, GA 30260  
[www.totousa.com](http://www.totousa.com)

Contact us

Validity: 09/02/16 – 09/02/22  
TOT – 09/02/16 – 018



## LCA & material health results & interpretation

## Standard EcoPower® Faucet with Mixing Valve

Life cycle assessment

Material health

### Evaluation program: Declare

**Declare** labels are issued to products disclosing ingredient inventory, sourcing and end of life options. Declare labels are based on the Manufacturers Guide to Declare, administered by the International Living Future Institute.

#### How it works

Material ingredients are inventoried and screened against the [Living Building Challenge](#) (LBC) Red List which represents the 'worst in class' materials, chemicals, and elements known to pose serious risks to human health and the greater ecosystem.

The Declare product database and label are used to select products that meet the Living Building Challenge's stringent materials requirements, streamlining the materials specification and certification process.

### Assessment scope and results

**Content inventory:** All ingredients identified by name and CAS #  
**Inventory threshold:** 100 ppm

#### Declaration status:

The Declare product database and label are used to select products that meet the LBC's stringent materials requirements, streamlining the materials specification and certification process.

- LBC Red List Free [?](#)
- LBC Compliant [?](#)
- Declared [?](#)

● **EcoPower® Standard Faucet with Thermostatic Mixing Valve**

● **EcoPower® Standard Faucet with Mixing Tee**



[Click on each label to see the full declaration](#)

### How this rating was achieved

#### Declare level

'Declared' is awarded to products when all the ingredients name and CAS numbers have been disclosed. 100% disclosure qualifies the product for the LEED v4 building product disclosure and optimization - material ingredients credit option 1.

#### What's in the product and why

The spout body and mixing valve are plated with chrome (Hexavalent Chromium VI). Chromium material is used as a decorative finish in applications where corrosion-resistance and durability are required. During the chrome plating process health hazards have been identified and are managed. Process controls are used to protect the environment and the production workers wear personal protection equipment. After the plating process the chrome surface is inert and does not pose any health risks. The parts in their final form do not represent any hazards to the user.

The TOTO facility in which the faucet is manufactured is ISO 14001 certified. This means that the facility has implemented an environmental management system as part of TOTO's commitment to the health of the environment.

#### Where it goes at the end of its life

TOTO encourages consumers to recycle their used faucets. Contact your local municipality for recycling programs.

### How we're making it healthier

The EcoPower technology enables the faucet to operate off the energy grid and requires no routine battery replacement. This technology helps to reduce pollution and hazardous waste, thereby mitigating human health impacts.

[See how we make it greener](#)

### References

#### Declare

TOTO USA, Declare label for Standard EcoPower® Faucet TEL105 with Thermostatic Mixing  
TOTO USA, Declare label for Standard EcoPower® Faucet TEL105 with Mixing Tee

#### Manufacturer's Guide to Declare

A comprehensive guide providing information about the program, the assessment methodology, how to submit material data to obtain a Declare label and how they are used to meet the Health & Happiness and Materials Petals of the Living Building Challenge.

### Rating systems

#### LEED BD+C: New Construction | v4 - LEED v4

Building product disclosure and optimization

#### Material ingredients

Credit value options 1 product each

☒ 1. Reporting ☐ 2. Optimization ☐ 3. Supply chain optimization

#### Living Building Challenge

##### Materials petals imperatives

☐ 10. Red List Free ☐ 12. Responsible Industry ☐ 13. Living Economy Sourcing

#### WELL Building Standard®

##### Air and Mind Features

☐ **Air** 4. VOC reduction ☐ **Air** 26. Enhanced Material Safety

☒ **Mind** 97. Material Transparency ☐ **Mind** 98. Organizational Transparency



## SM Transparency Report™ + Material Health Overview™

#### VERIFICATION

LCA

3rd party verified



Transparency Report

Verified



Material evaluation

Self-declared



Validity: 09/02/16 – 09/02/22  
TOT – 09/02/16 – 018



The LCA and Report are independently verified to the SM Transparency Report / EPD Framework and ISO 14025.

**NSF International**  
P.O Box 130140  
789 N.Dixboro Road  
Ann Arbor, MI 48105, USA  
[www.nsf.org](http://www.nsf.org)  
+1 734 769 8010

The material health evaluation is self-declared and done in accordance with the Manufacturers Guide to Declare.

**International Living Future Institute**  
501 East Madison St.  
Seattle, WA 98122  
[www.living-future.org](http://www.living-future.org)  
206 223 2028



#### TOTO USA

1155 Southern Road  
Morrow, GA 30260  
[www.totousa.com](http://www.totousa.com)

Contact us

How we make it greener

Standard EcoPower® Faucet with Mixing Valve

[Collapse all](#)

[See LCA results by life cycle stage](#)

CONSTRUCTION




TOTO participates in the UPS Carbon Neutral program. TOTO is a certified SmartWay partner.

USE




TOTO's Standard EcoPower® Faucets feature the highly regarded EcoPower technology. Engineered to reduce environmental impacts, TOTO's EcoPower products offer water and energy savings without sacrificing performance. Below are some of the features of TOTO's EcoPower technology.

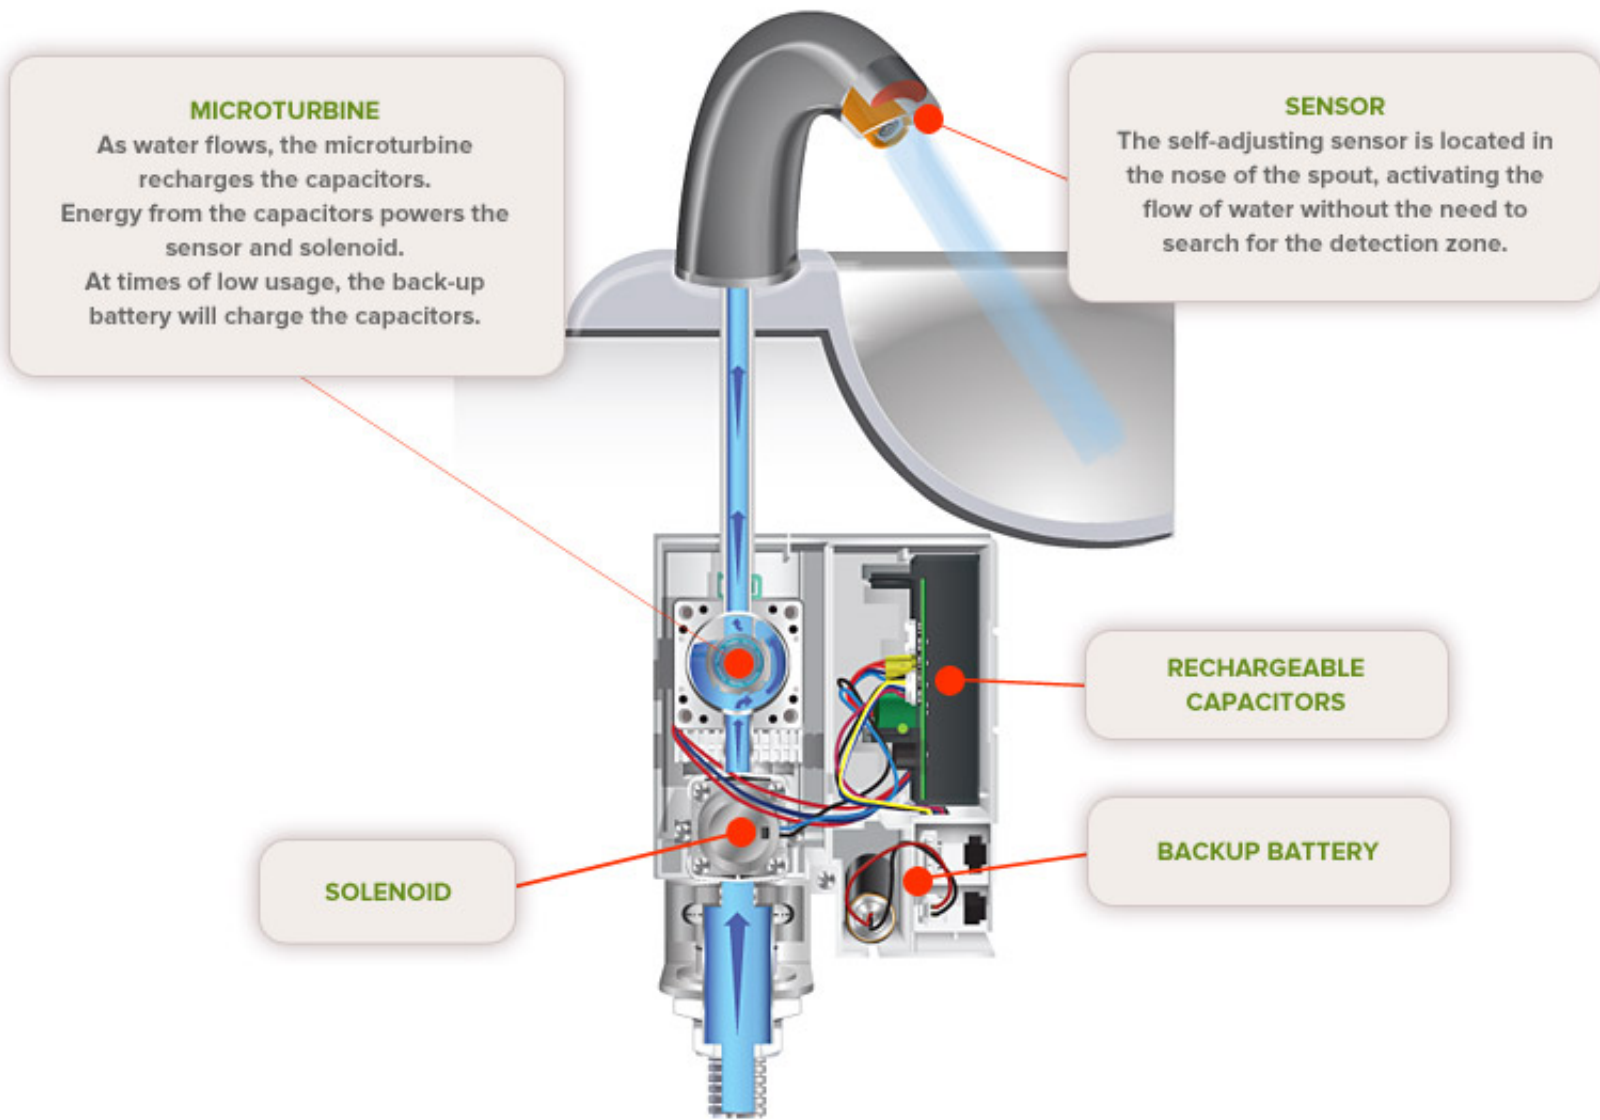

**SENSOR:**  
Located in the nose of the faucet, the EcoPower sensor ensures that water flows only when needed. The detection zone is right where you need it, eliminating the need to search with your hands to activate the flow of water. For on-demand versions, the sensor will stop the flow of water upon removal of the hands from the sensing zone, preventing wasted water.

**MICROTURBINE:**  
TOTO's EcoPower technology enables the product to operate 100% off grid. As water flows, the hydro powered microturbine recharges the capacitors for the sensor and solenoid. Less reliance on the back-up battery results in much less battery waste.

**SOLENOID:**  
The solenoid mechanism, a water-saving technology, maintains consistent flow rate under a range of supply pressures.

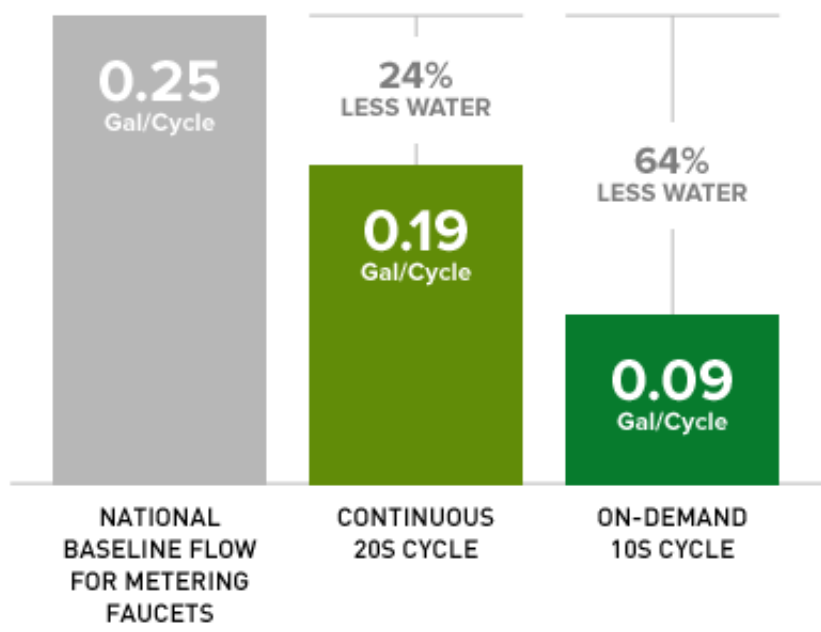

Using the same proven engineering as our legendary EcoPower TEL3/5G series, the low flow TEL105 series reinforces TOTO's performance reputation while offering additional water savings.



Metal and electronic parts can be recycled at the end of life.



SM Transparency Report™ + Material Health Overview™

VERIFICATION	LCA
3rd party verified	
Transparency Report	
Verified	
Material evaluation	
Self-declared	

Validity: 09/02/16 – 09/02/22  
TOT – 09/02/16 – 018

The LCA and Report are independently verified to the SM Transparency Report / EPD Framework and ISO 14025.

**NSF International**  
P.O Box 130140  
789 N.Dixboro Road  
Ann Arbor, MI 48105, USA  
[www.nsf.org](http://www.nsf.org)  
+1 734 769 8010



The material health evaluation is self-declared and done in accordance with the Manufacturers Guide to Declare.

**International Living Future Institute**  
501 East Madison St.  
Seattle, WA 98122  
[www.living-future.org](http://www.living-future.org)  
206 223 2028



**TOTO USA**  
1155 Southern Road  
Morrow, GA 30260  
[www.totousa.com](http://www.totousa.com)

Contact us